

Chromalox[®]

Installation Instructions

SERVICE REFERENCE

DIVISION 4

SECTION RDK


SALES REFERENCE (Supersedes PJ482-2)

PJ482-3

161-511930-006

DATE MARCH, 2004

RDK-1 Downspout Hanger Kit

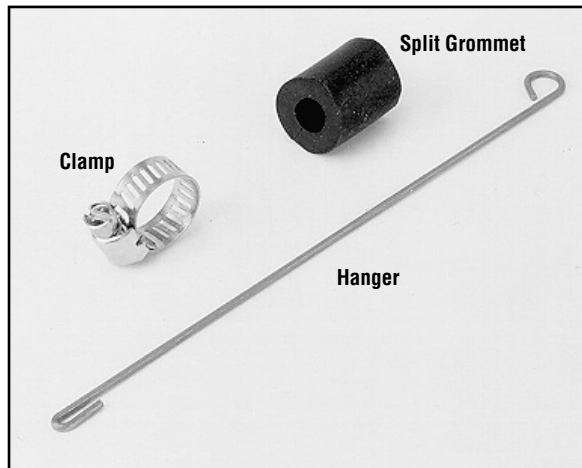

The RDK-1 Downspout Hanger Kit is used to suspend and prevent damage to Chromalox Roof and Gutter Heating Cable as it enters gutter downspout. This kit contains material for one downspout entrance.

INSTALLATION

⚠ WARNING

ELECTRIC SHOCK HAZARD. Disconnect all power before installing or servicing heating cable and accessories. A qualified person must perform installation and service of heating cable and accessories. Heating cable must be effectively grounded in accordance with the National Electrical Code. Failure to comply can result in personal injury or property damage.

Note: All electrical wiring, including GFCI (Ground Fault Circuit Interrupters), must be done according to National Electrical or local codes by a qualified person.

1. Place the split grommet around the heating cable where the downspout hanger will be placed.

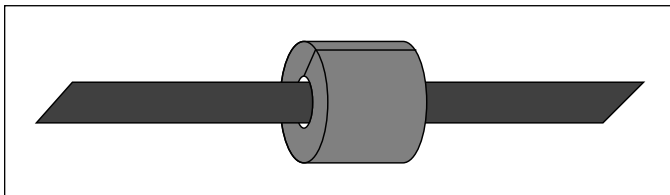


Figure 1

2. The wire hanger has a 180° hairpin bend at one end and a loop bend at the other end. Center the hairpin end of the wire hanger along the grommet. Slide the clamp over the wire hanger and into the bend of the hanger.

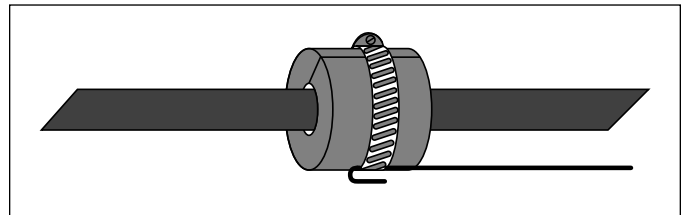


Figure 2

3. Tighten the clamp until the hanger and cable are firmly held in place.

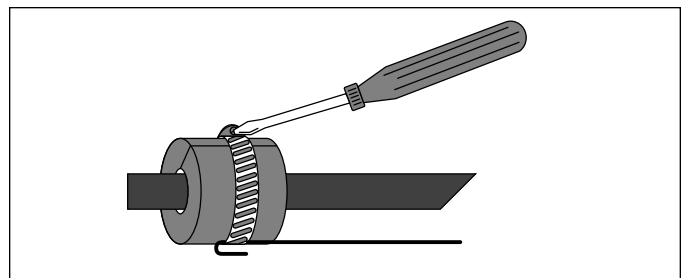


Figure 3

INSTALLATION

4. Attach the hanger assembly to the roof by driving a roofing nail or screw through the looped end of the hanger.

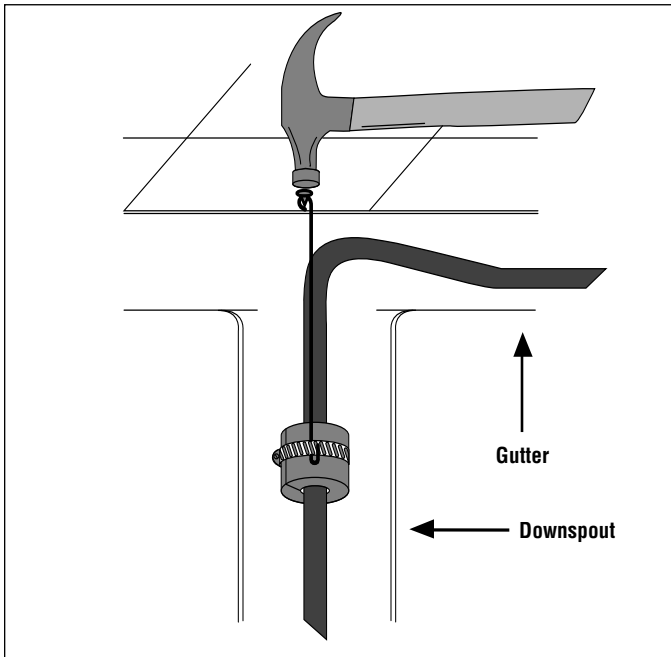


Figure 4

Limited Warranty:

Please refer to the Chromalox limited warranty applicable to this product at http://www.chromalox.com/customer-service/policies/terms_of_sale.aspx.

Chromalox[®]
PRECISION HEAT AND CONTROL

1347 HEIL QUAKER BLVD., LAVERGNE, TN 37086
Phone: (615) 793-3900 www.chromalox.com